


TP-600 Access control

Access control using dry contact switching from relay

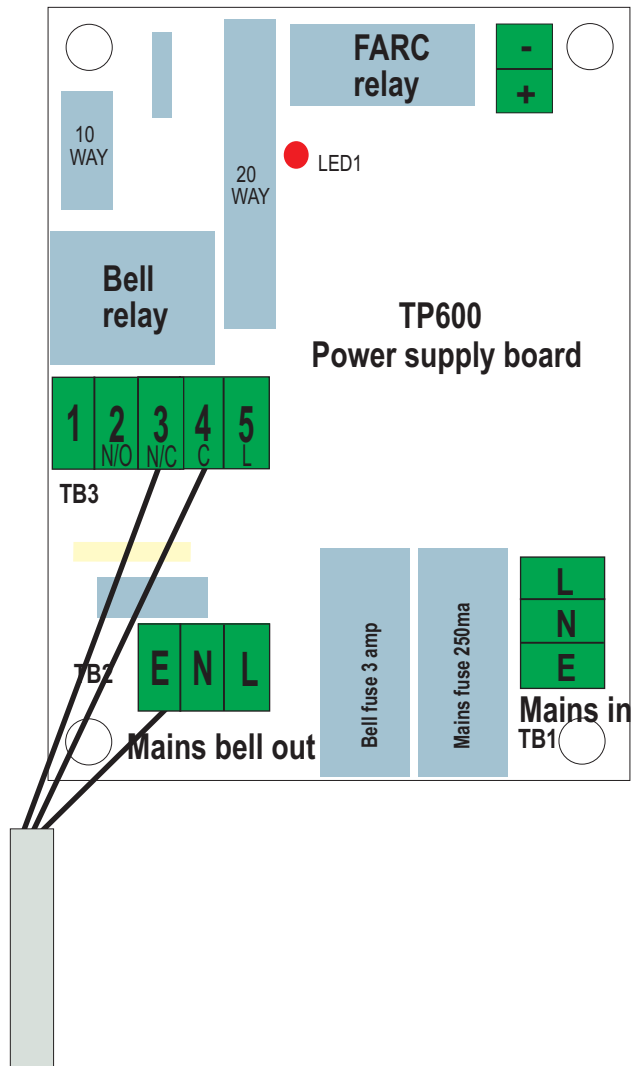

Cable to customers access control unit

INSTALLATION NOTES

1. On a normal access control system the customers access control unit will require connecting to a normally closed switch.

The diagram shows the connections to be used for this with the TP600 bell relay providing the normally closed contact on TB3 3 and 4.

The relay will **open** the connection when a clocking is made, releasing the door lock.

2. If the access control system requires a normally open connection, connect the cable to TB3 2 and 4 and then the relay will then **make** the connection when clocking.

3. The TP600 relay can switch any voltage from 5 to 240 volts ac or 5 to 120 dc.

Connect the earth if required.